

(b) Separation Requirements:

TABLE 2

SEPARATION DISTANCES FROM WASTEWATER SYSTEM COMPONENTS

System Components	Well or Suction Line	To Stream, Lake, watercourse (b), or Wetland	Dwelling	Property Line
House sewer (watertight joints)	25' if cast iron pipe, 50' otherwise	25'	3'	10'
Septic tank	50'	50'	10'	10'
Effluent line to distribution box	50'	50'	10'	10'
Distribution box	100'	100'	20'	10'
Absorption field	100' (a)	100'	20'	10'
Seepage pit	150' (a)	100'	20'	10'
Dry well (roof and footing)	50'	25'	20'	10'
Raised or Mound system (c)	100' (a)	100'	20'	10'
Evapotranspiration-absorption system (c)	100' (a)	50'	20'	10'
Composter	50'	50'	20'	10'

NOTES:

(a) When sewage treatment systems are located in coarse gravel or upgrade and in the general path of drainage to a well, the closest part of the treatment system shall be at least 200 feet away from the well.

(b) Mean high water mark.

(c) For all systems involving the placement of fill material, separation distances are measured from the toe of slope of the fill.

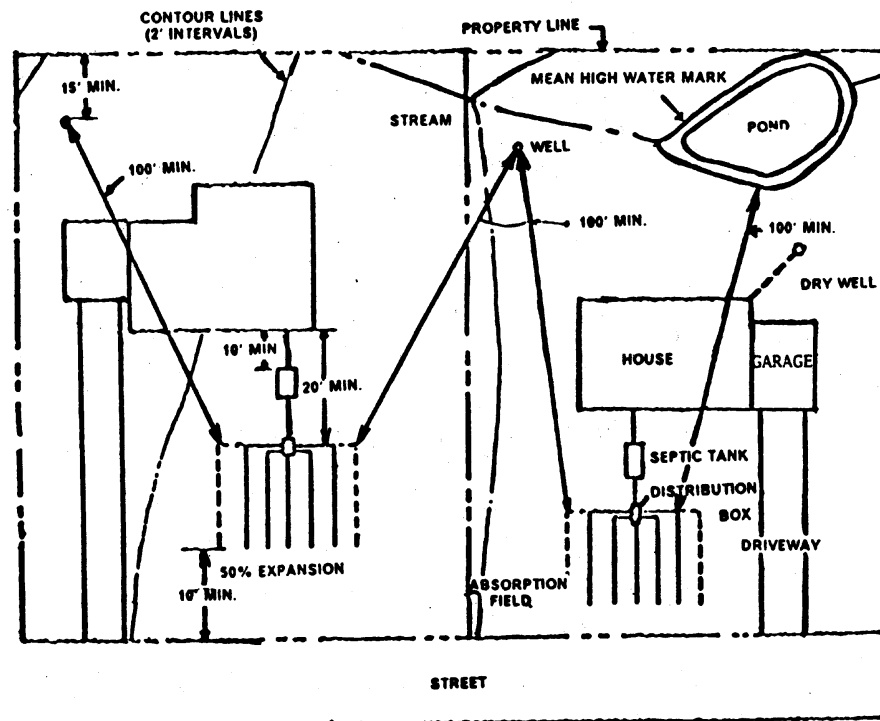


FIGURE 1

ABSORPTION FIELD SEPARATION REQUIREMENTS